



PARTIAL VIEW OF A TYPICAL SERVICE PANEL

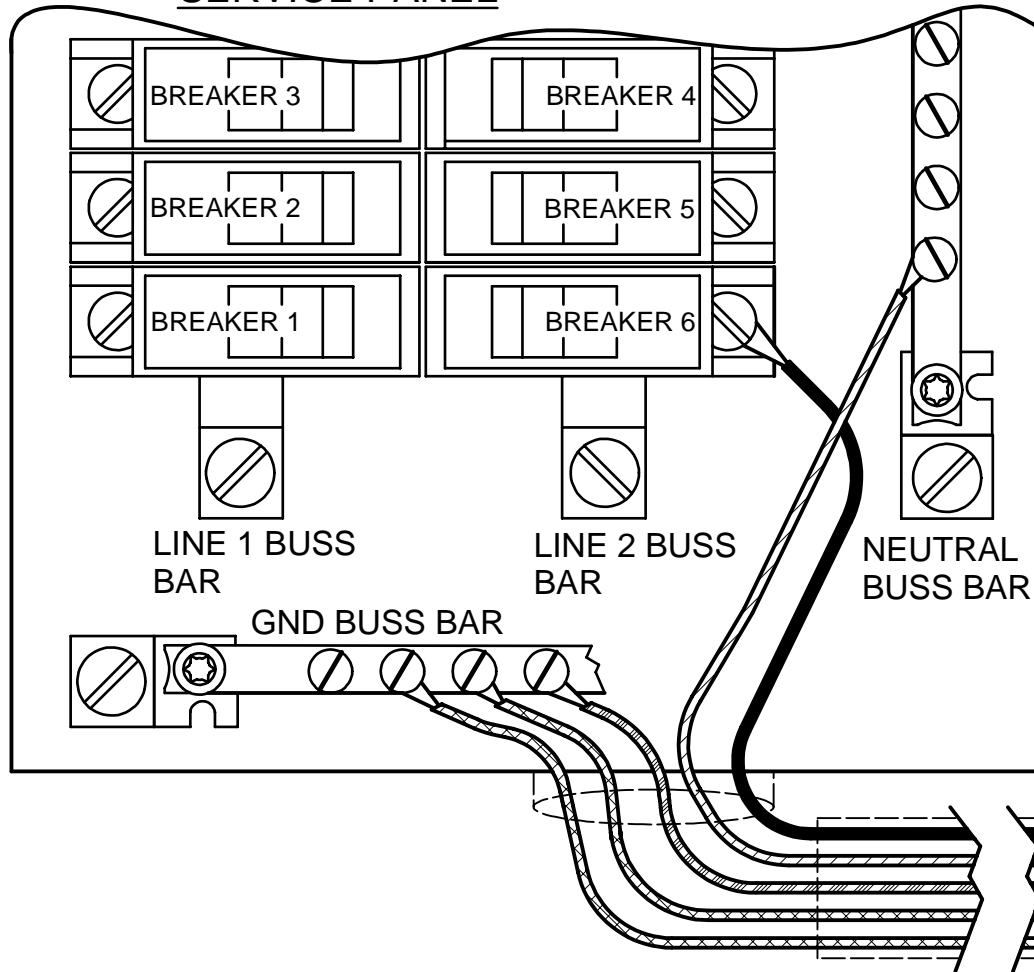

PARTIAL VIEW OF TMS

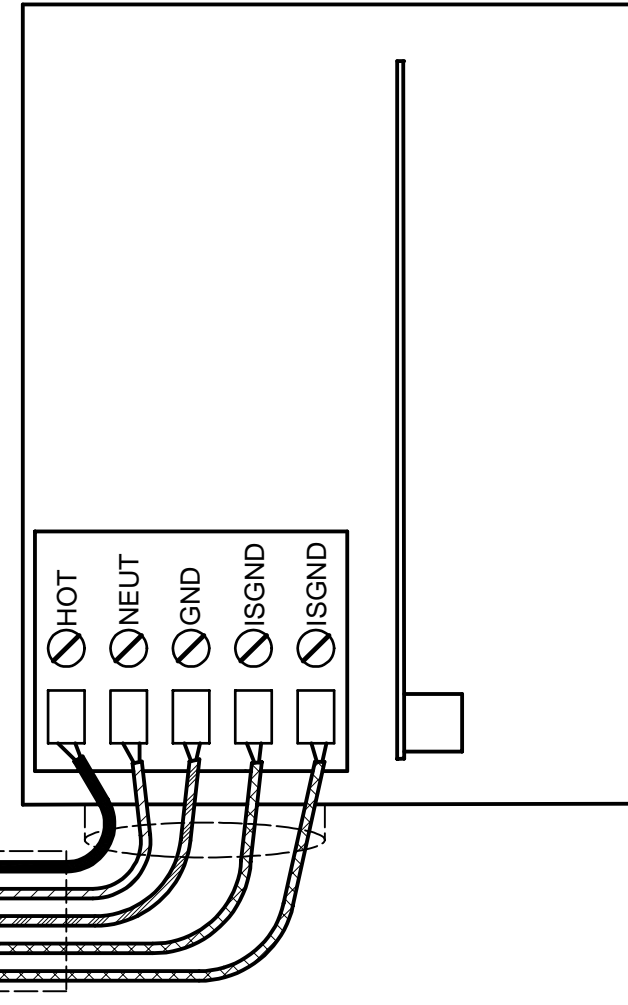

**NOTE:**

**ALL TMS GROUNDS MUST BE TERMINATED AT THE GND BUSS BAR IN THE SAME SERVICE PANEL AS TMS POWER. A GROUNDING ROD, COLDWATER PIPE OR OTHER CONNECTION SHOULD NOT BE USED.**

**PNEUMERCATOR COMPANY**  
Liquid Level Control Systems

120 FINN COURT FARMINGDALE, N.Y. 11735

**TMS SERIES GROUND WIRING**