


DIMENSIONS: INCHES [MM]

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REDRAWN ADDING SPECIFICATIONS AS PER EO920923-1 RLK	092392	
B	REDRAWN ACCORDING TO NEW DESIGN	082597	
C	ADD METRIC DIMS	072610	

TYPICAL INSTALLATION IN DOUBLE WALL TANK

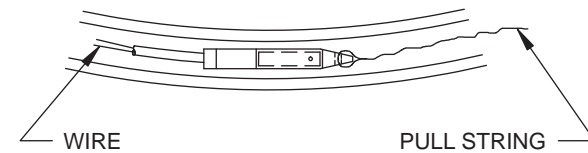

SPECIFICATIONS:

WETTED MATERIALS	ISOPLAST, NITRILE, EPOXY
OPERATING TEMP.	-40° F TO +150° F (-40° C TO TO +65.5° C)
ACCURACY	±1/8 INCH / 3.2 mm
SWITCH RATING	10W, 50-120 VDC RESISTIVE ONLY
CABLE	TWO (2) CONDUCTOR PVC JACKETED 25 (7.5M) FT. EXTENDED
APPROVALS	UL RECOGNIZED

INSTALLATION INSTRUCTIONS  
(FOR FIBERGLASS TANKS)

\* FISH TAPE SUPPLIED BY CUSTOMER

1. INSERT FISH TAPE THROUGH ANNULAR SPACE.
2. ATTACH PULL-STRING TO LS610.
3. TAG PULL-STRING AND CABLE EACH 20 (6.1M) FT. FROM LS610.
4. ATTACH FISH TAPE TO PULL-STRING.
5. PULL LS610 THROUGH ANNULUS.
6. MATCH TAG MARK ON SIGNAL CABLE AND PULL-STRING.
7. LS610 NOW POSITIONED BOTTOM CENTERLINE OF TANK.

PNEUMERCATOR COMPANY			
APPROVALS		DATE	
DRAWN RLK		080792	
CHECKED			
ISSUED			
SIZE CAGE CODE		DWG. NO.	REV.
B 47876		10 455	C
SCALE NONE		SHEET 1 OF 1	